


PLUMBING NOTES:

- A. THE PLUMBING SYSTEM FOR THIS WORK INCLUDES ALL COLD WATER DISTRIBUTION, DOMESTIC WATER HEATING AND DISTRIBUTION, VENTS, WASTES, AND PLUMBING ITEMS NEEDED FOR A COMPLETE AND PROPER INSTALLATION.
- B. THESE ITEMS AS INDICATED ON THE DRAWINGS SHALL BE INSTALLED IN ACCORDANCE WITH THE V.I. CODE AND THE AMERICAN STANDARD NATIONAL PLUMBING CODE, ASME.
- C. DRAINAGE, WASTE, VENT, AND POTABLE SUPPLY TO CISTERN PIPES AND FITTINGS SHALL BE PVC, TYPE 1, RATED 160 PSI AT 73 DEGREES F. COPPER TUBING (HOT WATER) SHALL BE TYPE L ABOVE GRADE AND TYPE K IN SLAB WITH PVC SLEEVES O SEPARATE STEEL AND COPPER. ALL JOINT FITTINGS SHALL BE SOLDERED. FLUX SHALL BE NON-CORROSIVE TYPE.

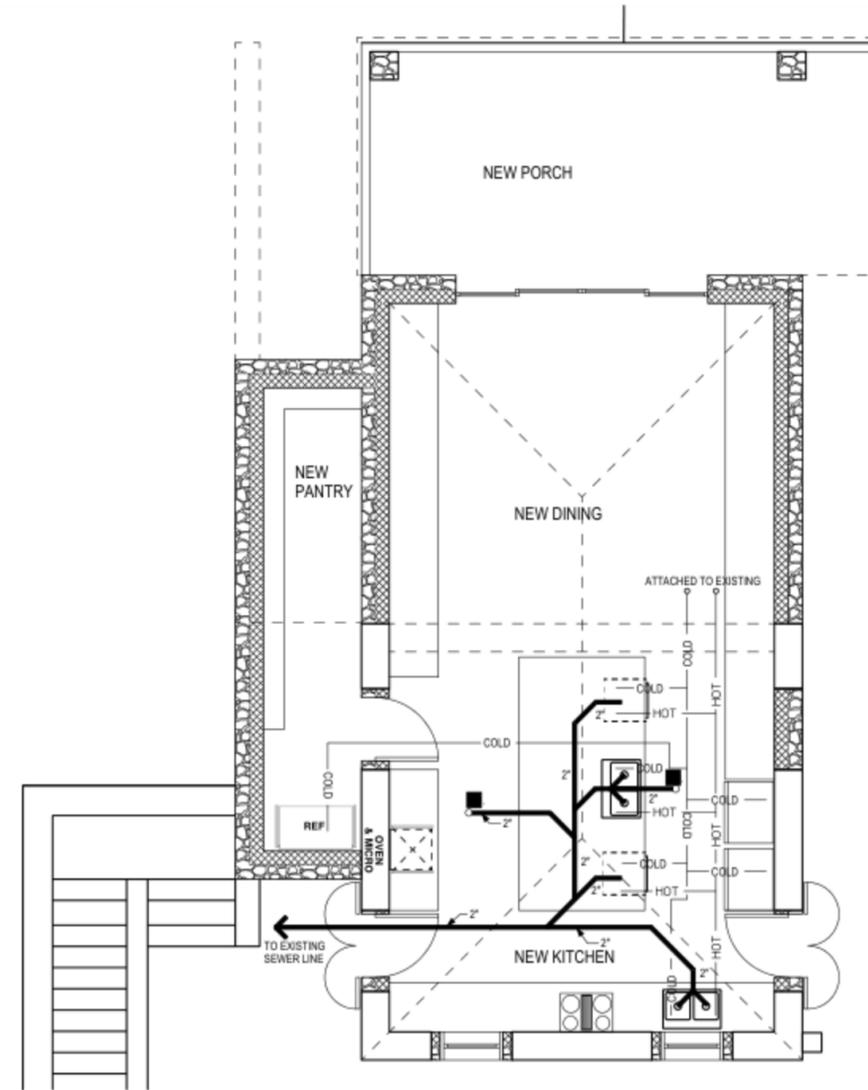

KITCHEN RENOVATION
 LITTLE ST. JAMES
 U.S. VIRGIN ISLANDS

PROPOSED PLUMBING LAYOUT AND NOTES

REVISIONS

NO.	DESCRIPTION

DRAWN BY:	O.C.
CHECKED BY:	deJONGH
SCALE:	1/4" = 1'-0"
DATE:	
JOB NO:	2008.21
SHEET:	

P1.01